

APPLICATION FOR SIDEWALK CONSTRUCTION OR
RECONSTRUCTION PERMIT

Name of Applicant: _____

Mailing Address: _____

Street address or general description of property upon which sidewalk
construction will take place: _____

Brief description of work to be done: _____

Approximate start date: _____

Approximate finish date: _____

The undersigned agrees that work to be performed (removal, reconstruction, or
installation) will comply with all ordinances and requirements of the City of
Humboldt, in accordance with Chapter 136 of the City Code of the City of
Humboldt, Iowa.

Applicant Signature: _____

Applicant Daytime Phone: _____

For office use only:

Approved by: _____

Date: _____

136.08 SIDEWALK STANDARDS. Sidewalks repaired, replaced or constructed under the provisions of this chapter shall be of the following construction and meet the following standards:

1. Cement. Portland cement shall be the only cement used in the construction and repair of sidewalks. The maximum design strength shall be 3500 pounds. The design mix shall be approved by the City engineer.
2. Construction. Sidewalks shall be of one-course construction.
3. Sidewalk Base. Concrete may be placed directly on compact and well-drained soil. Where soil is not well drained, a three-inch sub-base of compact, clean, coarse gravel or sand shall be laid. The adequacy of the soil drainage is to be determined by the City.
4. Sidewalk Bed. The sidewalk bed shall be so graded that the constructed sidewalk will be at established grade.
5. Length, Width and Depth. Length, width and depth requirements are as follows:
 - A. Residential sidewalks shall be at least four (4) feet wide and four (4) inches thick, and each section shall be no more than six (6) feet in length.
 - B. Business District sidewalks shall extend from the property line to the curb. Each section shall be four (4) inches thick and no more than six (6) feet in length and width.
 - C. Driveway areas shall be not less than six (6) inches in thickness.
6. Location. Residential sidewalks shall be located with the inner edge (edge nearest the abutting private property) two (2) feet from the property line, unless the Council establishes a different distance due to special circumstances.
7. Grade. Curb tops shall be on level with the centerline of the street which shall be the established grade.
8. Elevations. The street edge of a sidewalk shall be at an elevation even with the curb at the curb or not less than one-quarter ($\frac{1}{4}$) inch above the curb for each foot between the curb and the sidewalk.
9. Slope. All sidewalks shall slope one-quarter ($\frac{1}{4}$) inch per foot toward the curb.
10. Finish. All sidewalks shall be finished with a "broom" or "wood float" finish.
11. Ramps for Persons with Disabilities. There shall be not less than two (2) curb cuts or ramps per lineal block which shall be located on or near the crosswalks at intersections. Each curb cut or ramp shall be at least thirty (30) inches wide, shall be sloped at not greater than one inch of rise per twelve (12) inches lineal distance, except that a slope no greater than one inch of rise per eight (8) inches lineal distance may be used where necessary, shall have a nonskid surface, and shall otherwise be so constructed as to allow reasonable access to the crosswalk for persons with disabilities using the sidewalk.

(Code of Iowa, Sec. 216C.9)

Any sidewalk constructed contrary to the provisions of this chapter shall be subject to removal and reconstruction. The Council shall serve notice on the abutting property owner requiring the owner to remove and reconstruct the sidewalk within a reasonable time and if such action is not completed within the time stated in the notice, the Council may require the work to be done and assess the costs against the abutting property for collection in the same manner as a property tax.

Construction Materials, Inc.

560 Waconia Ct SW - Cedar Rapids, IA 52404 - (319) 366-6446 - FAX (319) 366-1712
5210 NE 17th St. - Des Moines, IA 50313 - (515) 263-9006 - FAX (515) 263-8326

- NEW PRODUCT -

ADA Truncated Dome Panel

PRECAST WARNING PANELS FOR PEDESTRIAN CURB RAMPS

ADA Truncated Dome Panels are precast glass fiber reinforced concrete (G.F.R.C.). The panels are manufactured using a cement/aggregate slurry reinforced throughout with alkali resistant fibers.

SPECIFICATION - COMPLIANCE



Meets the American Disabilities Act (ADA).
7000-7500 psi

SIZE - COLOR

24" x 1-1/4" x 24"

Standard colors: brick red and charcoal gray

(special order colors available)

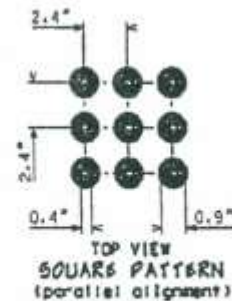

Manufactured by:
Hand and Spirit, Inc.
910 North 20th
Denison, IA 51442



Construction Materials, Inc.

Dave Olson

560 Waconia Ct. SW
Cedar Rapids, IA 52404
(319) 366-6446
1-800-747-6401
FAX: (319) 366-1712
Mobile: (319) 331-7696

5210 NE 17th Street
Des Moines, IA 50313
(515) 263-9006
FAX (515) 263-8326